

ift-Nachweis



Number	18-002502-PR01 (NW-H01-09-en-02)
Owner	Faltenbacher Jalousienbau GmbH & Co. KG Im Gewerbepark 15 92681 Erbandorf Germany
Product	Insulating glazing units (IGU) with integrated movable devices
Designation	System: ISOLETTE Jalousienisoliervglas
Details	Overall dimensions (W x H) 2700 mm x 1500 mm, 1500 mm x 3000 mm; Glass configuration Float 8 mm / Aluminium frame with U-guide, EV-1 anodized, Jalousie system Isolette I-06 model 1 32 mm / Float 8 mm
Special features	-/-

Result **)



The requirements of ift guideline VE07/3, section 6, for durability (20,000 cycles) are fulfilled.

Basis *)


ift-Richtlinie VE-07/3:2018-11
) and corresponding national versions
(e.g. DIN EN)

Test report: 18-002502-PR01 PB-H01-09-de-02

Replace ift-Nachweis

18-002502-PR01 NW-H01-09-en-01 dated 11.05.2021

Representation

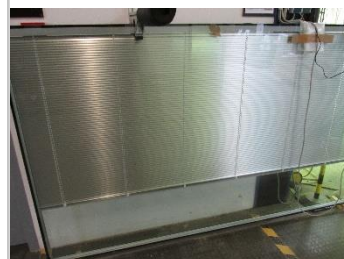

Instructions for use

The results obtained can be used as evidence in accordance with the above basis

**) Decision rule: For the conformity assessment, the determined measurement results were assumed to be error-free values.

Validity

There is no time limit.

When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and results given relate solely to the tested/described specimen. This test/evaluation does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: ODE-B3CB8

ift Rosenheim

10.06.2021

Michael Freinberger, Dipl.-Ing. (FH)
Head of Testing Department
Material Testing

Stefan Hehn, Dipl.-Ing. (FH)
Operating Testing Officer
Material Testing