

Number	23-002402-PR01 (NW A1A2-H01-04-en-01)
Owner	Faltenbacher Jalousienbau GmbH & Co. KG Im Gewerbepark 15 92681 Erbendorf Germany
Product	Insulation glass unit with curtain
Designation	Shipping name: Isolette 3fach_VSG12SI-32-6-12-VSG8SI
Details	Manufacturer Faltenbacher Jalousienbau, GmbH & Co. KG - Erbendorf; Overall dimensions (W x H) 1230 mm x 1480 mm; Glass configuration LSGacoustic 12 / air, with curtain 32 / TSG 6 / air 12 / LSGacoustic 8; Type of Gas Air; Gas filling rate in cavity 1 100 %; Gas filling rate in cavity 2 100 %; Surface weight 68.4 kg/m ²
Special features	Outer space between glass panes with built-in sunblind, Testing with curtain raised and lowered

Result

Weighted Sound Reduction Index R_w and Spectrum-Adaptation Terms C and C_{tr} according to EN ISO 10140-2:2021-05, EN ISO 717-1:2020-12




$$R_w (C; C_{tr}) = 53 (-2; -6) \text{ dB}$$

Basis *)

EN ISO 717-1:2020-12
EN ISO 10140-1:2021-05
EN ISO 10140-2:2021-05
*) and corresponding national versions (e.g. DIN EN)

Test report: 23-002402-PR01 PB A1A2-H01-04-de-01

Representation

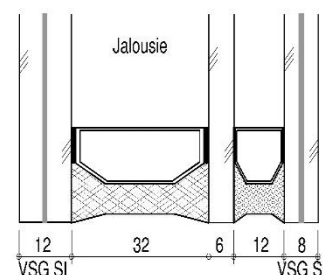

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit. When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim

28.07.2023



Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics



Florian Dangel, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: 2F0-D52CB